



**WILMAR™ Protective Relays – 700 Series**

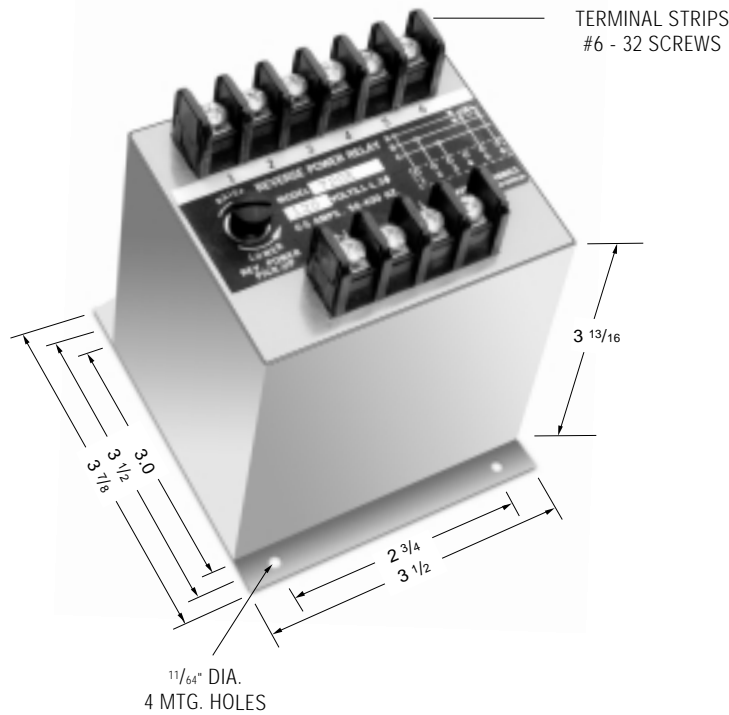


**Note:** Dimensions in inches. Multiply values by 25.4 for dimensions in mm.

Model 710 (X)  
Designed for 120, 220 or 266 volt  
line to neutral connection



Model 720 (X) thru 724 (X)  
For operation on three phase,  
three wire circuits




**Function:** 32

- ANSI/IEEE C37.90-1978
- UL file No. E58048
- CSA file No. LR61158



Several types of Reverse Power Relays are available including relays sensitive to reverse reactive power (KVAR). WILMAR is the leading brand of reverse power relays. Our rugged sealed construction provides continuous and reliable operation unaffected by shock, vibration or other severe environments. Reverse Power Relays are used for the protection of generator sets operating in parallel.

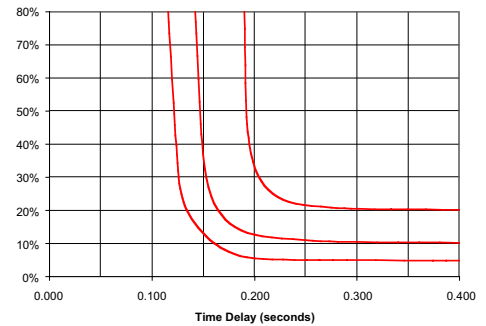

**PRODUCT SPECIFICATIONS**

Part Number	700 Series
Line Voltage.....	Model 710X = 120 V, 220 V or 266 V line to neutral sensing
Line Frequency.....	50-500 Hz.
Current Requirements.....	0 to 5 amp max direct or from CT with 5 amp secondary
Trip Adjustment.....	Screwdriver adjustable 4% to 20% (of the 5 amp rating)
Time Delay.....	Inverse Delay - See Chart
Output Contacts.....	One set N.O., one set N.C.
Contact Ratings.....	5 amp resistive at 120 AC or 28 Vdc
Power Consumption.....	Voltage circuit: 2 VA max. Current circuit: 4 VA max.

**PART NUMBER SELECTION**

Sample Part No. 710X  
**Type:** ± 20%  
 710 = 120 V, 220 V, 266 V line to neutral  
 720 = 120 V, L-L, 3 Phase  
 721 = 230 V, L-L, 3 Phase  
 722 = 380 V, L-L, 3 Phase  
 723 = 460 V, L-L, 3 Phase  
 724 = 575 V, L-L, 3 Phase  
 725 = 416 V, L-L, 3 Phase

**Mounting:**

X = Flange  
Blank = Stud

**Options:**

7 = Reverse Inductive  
P = Surge Suppression

Consult factory for additional models.

**Notes:**

1. Remove screw for access to the pick-up adjustment.
2. Clockwise rotation of the adjustment will raise the reverse trip point.
3. This relay senses true power, which is a product of voltage, current and phase angle. Connections and polarity must be observed in accordance with the provided diagrams.